Design No. U305

February 19, 2019

Bearing Wall Rating — 1 Hr
Finish Rating — See Items 3, 3A, 3D, 3E, 3F, 3G, 3H, 3J and 3L.
STC Rating - 56 (See Item 9)

This design was evaluated using a load design method other than the Limit States Design Method (e.g., Working Stress Design Method). For jurisdictions employing the Limit States Design Method, such as Canada, a load restriction factor shall be used — See Guide BXUV or BXUV7

* Indicates such products shall bear the UL or cUL Certification Mark for jurisdictions employing the UL or cUL Certification (such as Canada), respectively.

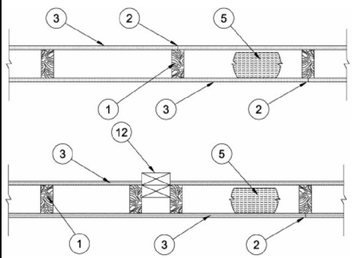

1. Wood Studs — Nom 2 by 4 in. spaced 16 in. OC max, effectively firestopped.

2. Joints and Nail-Heads — Joints covered with joint compound and paper tape. Joint compound and paper tape may be omitted when square edge boards are used. As an alternate, nom 3/32 in. thick gypsum veneer plaster may be applied to the entire surface of Classified veneer baseboard with the joints reinforced with paper tape. Nailheads exposed or covered with joint compound.

3. Gypsum Board* — 5/8 in. thick paper or vinyl surfaced, with beveled, square, or tapered edges, applied either horizontally or vertically. Gypsum panels nailed 7 in. OC with 6d cement coated nails 1-7/8 in. long, 0.0915 in. shank diam and 15/64 in. diam heads. When used in widths other than 48 in., gypsum panels are to be installed horizontally.

   ACADIA DRYWALL SUPPLIES LTD — Type X (finish rating 22 min), 5/8 Type X, Moisture Resistant Type X, Gypsum Sheathing Type X, Mold & Mildew Resistant Type X and Mold & Mildew Resistant AR Type X, Type Blueglass Exterior Sheathing

   AMERICAN GYPSUM CO — Types AGX-1(finish rating 23 min.), M-Glass (finish rating 23 min.), Type AGX-11 (finish rating 26 min), Type AGX-12 (finish rating 22 min), Type LightRoc (finish rating 23 min.) or Type AG-C

   BEIJING NEW BUILDING MATERIALS PUBLIC LTD CO — Type DBX-1 (finish rating 24 min)

   CERTAINTEED GYPSUM INC — Type 1, Type SF3 (finish rating 20 min) or FRPC; Type C. Type X-2, Type X or Type X-1 (finish rating 26 min); Type EGRG or GlasRoc (finish rating 23 min), GlasRoc-2, Type Habito (finish rating 26 min).

   CGC INC — Type AR (finish rating 24 min), Type C (finish rating 24 min), Type IP-AR (finish rating 24 min), Type IPC-AR (finish rating 24 min), Type IP-X1 (finish rating 24 min), Type IP-X2 (finish rating 24 min), Type SCX (finish rating 24 min), Type SHX (finish rating 24 min), Type ULX (finish rating 22 min), Type WRC (finish rating 24 min), Type WRX (finish rating 24 min)

   CONTINENTAL BUILDING PRODUCTS OPERATING CO, L L C — Type LGFC6A (finish rating 34 min), Type LGFC2A, Type LGFC-C/A, Type LGFC-WD, Type LGLLX (finish rating 21 min)

   GEORGIA-PACIFIC GYPSUM L L C — Type 5 (finish rating 26 min), Type 6 (finish rating 23 min), GEORGIA-PACIFIC GYPSUM L L C — Type 5 (finish rating 26 min), Type 6 (finish rating 23 min), Type 9 (finish rating 26 min), Type C (finish rating 26 min), Type DGG (finish rating 20 min), Type GPFS1 (finish rating 20 min), Type GPFS2 (finish rating 20 min), Type GPFS6 (finish rating 26 min), Type DS, Type DAP, Type DD (finish rating 20 min), Type DA, Type DAPC, Type LS (finish rating 23 min), Type X, Veneer Plaster Base - Type X, Water Rated - Type X, Sheathing - Type X, Soffit - Type X, Type LWX (finish rating 22 min), Veneer Plaster Base-Type LWX (finish rating 22 min), Water Rated-Type LWX (finish rating 22 min), Sheathing Type-LWX (finish rating 22 min), Soffit-Type LWX (finish rating 22 min), Type DGLW (finish rating 22 min), Water Rated-Type DGLW (finish rating 22 min), Sheathing Type- DGLW (finish rating 22 min), Soffit-Type DGLW (finish rating 22 min), Type LWX (finish rating 22 min), Type LW2X (finish rating 22 min), Veneer Plaster Base - Type LW2X (finish rating 22 min), Water Rated - Type LW2X (finish rating 22 min), Sheathing - Type LW2X (finish rating 22 min), Soffit - Type LW2X (finish rating 22 min), Type DGL2W (finish rating 22 min), Water Rated - Type DGL2W (finish rating 22 min), Sheathing - Type DGL2W (finish rating 22 min)

   NATIONAL GYPSUM CO — Type FSK (finish rating 20 min), Type FSK-G (finish rating 20 min), Type FSW (finish rating 20 min), Type FSW-2 (finish rating 24 min), Type FSW-3 (finish rating 20 min), Type FSW-5 (finish rating 22 min), Type FSW-G (finish rating 20 min), Type FSK-C (finish rating 20 min), Type FSW-C (finish rating 20 min), Type FSMR-C, Type FSW-6 (finish rating 20 min), Type FSL (finish rating 24 min), Type FSW-8, Type FSLX (finish rating 21 min).

   NATIONAL GYPSUM CO — Riyadh, Saudi Arabia — Type FR, or WR.

   PABCO BUILDING PRODUCTS L L C, DBA PABCO GYPSUM — Types C, PG-2 (finish rating 20 min), PG-3 (finish rating 20 min), Types PG-3W, PG-5W (finish rating 20 min), Type PG-4 (finish rating 20 min), Type PG-6 (finish rating 23 min), Types PG-5WS, PGS-WRS (finish rating 20 min), Types PG-5, PG-9 (finish rating 26 min), PG-11 PG-13 (Nails increased to 2 in.), or Type PG-C

   PANEL REY S A — Type GREX, PRX, PRC, PRC2; Types RHX, MDX, ETX (finish rating 22 min)

   SIAM GYPSUM INDUSTRY (SARABURI) CO LTD — Type EX-1 (finish rating 26 min)

   THAI GYPSUM PRODUCTS PCL — Type C, Type X (finish rating 26 min)

   UNITED STATES GYPSUM CO — Type AR (finish rating 24 min), Type C (finish rating 24 min), Type FRX-G (finish rating 29 min), Type IP-AR (finish rating 24 min), Type IPC-AR (finish rating 24 min), Type IP-X1 (finish rating 24 min), Type IP-X2 (finish rating 24 min), Type SHX (finish rating 24 min), Type SCX (finish rating 24 min), Type SGX (finish rating 24 min), Type ULX (finish rating 22 min), Type WRX (finish rating 24 min), Type WRC (finish rating 24 min), Type ULIX (finish rating 20 min)

   USG BORAL DRYWALL SFZ LLC — Type SGX (finish rating 24 min).

   USG MEXICO S A DE C V — Type AR (finish rating 24 min), Type C (finish rating 24 min), Type WRX (finish rating 24 min), Type WRC (finish rating 24 min), Type IP-X1 (finish rating 24 min), Type IP-X2 (finish rating 24 min), Type SHX (finish rating 24 min), SCX (finish rating 24 min), Type IP-AR (finish rating 24 min), Type IPC-AR (finish rating 24 min), Type ULX (finish rating 22 min)

4. Steel Corner Fasteners — (Optional) — For use at wall corners. Channel shaped, 2 in. long by 1 in. high on the back side with two 1/8 in. wide cleats protruding into the 5/8 in. wide channel, fabricated from 24 gauge galv steel. Fasteners applied only to the end or cut edge (not along tapered edges) of the gypsum board, no greater than 2 in. from corner of gypsum board, max spacing 16 in. OC. Nailed to adjacent stud through tab using one No. 6d cement coated nail per fastener. Corners of wall board shall be nailed to top and bottom plate using No. 6d cement coated nails.

5. Batts and Blankets* — (Optional — Required when Item 6A is used (RC-11)) — Glass fiber or mineral wool insulation. Placed to completely or partially fill the stud cavities. When Item 6A is used, glass fiber or mineral wool insulation shall be friction-fitted to completely fill the stud cavities.

   CERTAINTEED CORP

   JOHNS MANVILLE

   KNAUF INSULATION LLC

   MANSON INSULATION INC

   OWENS CORNING HT INC, DIV OF OWENS CORNING — Corning Fiberglas Corp

   ROCK WOOL MANUFACTURING CO — Delta Board

   ROCKWOOL — Acoustical Fire Batts

   THERMAFIBER INC — Type SAFB, SAFB FF

7. Furring Channel — Optional — Not Shown — For use on one side of the wall - Resilient channels, 25 MSG galv steel, spaced vertically 24 in. OC, flange portion screw attached to one side of studs with 1-1/4 in. long diamond shaped point, double lead Phillips head steel screws. When resilient channels are used, insulation, Items 5C or 5D is required.

8. Caulking and Sealants — (Not Shown, Optional) — A bead of acoustical sealant applied around the partition perimeter for sound control.

9. STC Rating — The STC Rating of the wall assembly is 56 when it is constructed as described by Items 1 through 6, except:

   A. Item 2, above — Nailheads Shall be covered with joint compound.

   B. Item 2, above — Joints As described, shall be covered with fiber tape and joint compound.

   C. Item 5, above — Batts and Blankets* The cavities formed by the studs shall be friction fit with R-19 unfaced fiberglass insulation batts measuring 6-1/4 in. thick and 15-1/4 in. wide.

   D. Item 6, above — Steel Framing Members* Type RSIC-1 clips shall be used to attach gypsum board to studs on either side of the wall assembly.

   E. Item 8, above — Caulking and Sealants (Not Shown) A bead of acoustical sealant shall be applied around the partition perimeter for sound control.

   F. Steel Corner Fasteners (Item 4), Fiber, Sprayed (Items 5A and 5B) and Steel Framing Members (Item 6A), not evaluated as alternatives for obtaining STC rating.

10. Wall and Partition Facings and Accessories* — (Optional, Not Shown) — Nominal 1/2 in. thick, 4 ft wide panels, for optional use as an additional layer on one or both sides of the assembly. Panels attached in accordance with manufacturer's recommendations. When the QR-500 or QR-510 panel is installed between the wood framing and the UL Classified gypsum board, the required UL Classified gypsum board layer(s) is/are to be installed as indicated as to fastener type and spacing, except that the required fastener length shall be increased by a minimum of 1/2 in. Not evaluated or intended as a substitute for the required layer(s) of UL Classified Gypsum Board.

    PABCO BUILDING PRODUCTS L L C, DBA PABCO GYPSUM — Type QuietRock QR-500 and QR-510

11. Cementitious Backer Units* — (Optional Item Not Shown — For Use On Face Of 1 Hr Systems With All Standard Items Required) - 7/16 in., 1/2 in., 5/8 in., 3/4 in. or 1 in. thick, min. 32 in. wide. Applied vertically or horizontally with vertical joints centered over studs. Fastened to studs and runners with cement board screws of adequate length to penetrate stud by a minimum of 3/8 in. for steel framing members, and a minimum of 3/4 in. for wood framing members spaced a max of 8 in. OC. When 4 ft. wide boards are used, horizontal joints need not be backed by framing.

    NATIONAL GYPSUM CO — Type DuraBacker, PermaBase, DuraBacker Plus, or PermaBase Plus

12. Non-Bearing Wall Partition Intersection — (Optional) —Two nominal 2 by 4 in. studs or nominal 2 by 6 in. studs nailed together with two 3 in. long 10d nails spaced a max. 16 in. OC, vertically and fastened to one side of the minimum 2 by 4 in. stud with 3 in. long 10d nails spaced a max. 16 in. OC. vertically. Intersection between partition wood studs to be flush with the 2 by 4 in. studs. The wall partition wood studs are to be framed by with a second 2 by 4 in. wood stud fastened with 3 in. long 10d nails spaced a max. 16 in. OC. vertically. Maximum one non-bearing wall partition intersection per stud cavity. Non-bearing wall partition stud depth shall be at a minimum equal to the depth of the bearing wall.

13. Mesh Netting — (Not Shown) — Any thin, woven or non-woven fibrous netting material attached with staples to the outer face of one row of studs to facilitate the installation of the sprayed fiber from the opposite row.

14. Mineral and Fiber Board* — (Optional, Not Shown) — For optional use as an additional layer on one side of wall. Nom 1/2 in. thick, 4 ft wide with long dimension parallel and centered over studs. Attached to framing with minimum 1-3/8 in. long ring shanked nails or 1-1/4 in. long Type W steel screws, spaced 12 in. OC along board edges and 24 in. OC in field of board along intermediate framing. Not evaluated or intended as a substitute for the required layer(s) of UL Classified Gypsum Board.

    HOMASOTE CO — Homasote Type 440-32

14A. Mineral and Fiber Board* — (Optional, Not Shown) — For use with Items 14B-14E) — For optional use as an additional layer on one side of wall. Nom 1/2 in. thick, 4 ft wide with long dimension parallel and centered over studs. Attached to framing with minimum 1-3/8 in. long ring shanked nails or 1-1/4 in. long Type W steel screws, spaced 12 in. OC along board edges and 24 in. OC in field of board along intermediate framing. Not evaluated or intended as a substitute for the required layer(s) of UL Classified Gypsum Board.

    HOMASOTE CO — Homasote Type 440-32

14B. Glass Fiber Insulation — (For use with Item 14A) — 3-1/2 in. thick glass fiber batts bearing the UL Classification Marking as to Surface Burning and/or Fire Resistance, placed to fill the interior of the wall. See Batts and Blankets (BKNV or BZJZ) categories for names of Classified companies.

14C. Batts and Blankets* — (As an alternate to Item 14B, For use with Item 14A), 3 in. thick mineral wool batts, placed to fill interior of wall, attached to the 3-1/2 in. face of the studs with staples placed 24 in. OC.

    THERMAFIBER INC — Type SAFB, SAFB FF

14D. Adhesive — (For use with Item 14A) — Construction grade adhesive applied in vertical, serpentine, nominal 3/8 in. wide beads down the length of both vertical edges of Mineral and Fiber Board (Item 14A).

14E. Gypsum Board* — (For use with Item 14A) — 5/8 in. thick, 4 ft wide, applied vertically over Mineral and Fiber Board (Item 14A) with vertical joints located anywhere over stud cavities. Secured to mineral and fiber boards with 1-1/2 in. Type G Screws spaced 8 in. OC along edges of each vertical joint and 12 in. OC in intermediate field of the Mineral and Fiber Board (Item 14A). Secured to outermost studs and bearing plates with 2 in. long Type S screws spaced 8 in. OC. Gypsum Board joints covered with paper tape and joint compound. Screw heads covered with joint compound. Finish Rating 30 Min.

    AMERICAN GYPSUM CO — Type AG-C

    CERTAINTEED GYPSUM INC — Type FRPC, Type C, Type X-2

    CGC INC — Types C, IP-X2, IPC-AR

    CONTINENTAL BUILDING PRODUCTS OPERATING CO, L L C — Type LGFC-C/A

    GEORGIA-PACIFIC GYPSUM L L C — Types 5, DAPC, TG-C

    NATIONAL GYPSUM CO — Types FSK-C, FSW-C

    PABCO BUILDING PRODUCTS L L C, DBA PABCO GYPSUM — Type PG-C

    PANEL REY S A — Type PRC

    THAI GYPSUM PRODUCTS PCL — Type C

    UNITED STATES GYPSUM CO — Types C, IP-X2, IPC-AR

    USG BORAL DRYWALL SFZ LLC — Type C

    USG MEXICO S A DE C V — Types C, IP-X2, IPC-AR

* Indicates such products shall bear the UL or cUL Certification Mark for jurisdictions employing the UL or cUL Certification (such as Canada), respectively.

UL DESIGN: U305

1 G100 SCALE: 1/4" = 1'-0"

GENERAL LIFE SAFETY NOTES

1. OPENINGS BETWEEN THE NARTHEX S100 AND FOYER S104A ARE ALTERED IN THE ALTERNATE S-1 LAYOUT. HOWEVER, THE TOTAL NEW EXISTS FROM THE SANCTUARY EXCEEDS THE REQUIREMENTS OF THE NCSBC. TOTAL OCC. LOAD OF SANCTUARY 1048 IS 845. REQUIRED EXIT NUMBER IS 3 PER TABLE 1021.1 AND WIDTH REQUIRED IS 169". THERE REMAIN 6 EXITS FROM THE SANCTUARY WITH A TOTAL WIDTH OF 288".
2. EXIT SEPARATION SHALL BE 1/2 THE DIAGONAL DIMENSION OF THE FLOOR PLATE FOR THE FLOOR PER NCSBC SECTION 1015.2.1. THE EXITS SHOWN ARE EXISTING TO REMAIN.
3. FIRE EXTINGUISHER CABINETS ARE EXISTING TO REMAIN, THE PROPOSED CHANGES DO NOT EFFECT EXISTING LOCATIONS.
4. G.C. TO COORDINATE INSTALLATION REQUIREMENTS OF EXIT SIGNS, ALL ASSOCIATED HARDWARE, JUNCTION BOXES, WIRING AND REQUIRED EXIT DEVICES W/ ELECTRICAL DRAWINGS AND LOCAL AHJ.
5. TOTAL OCCUPANCY FOR THE EXISTING SANCTUARY BUILDING REMAINS UNCHAGED AT = 1147.

LIFE SAFETY PLAN LEGEND

- FPC — SURFACE MOUNTED 10LB. ABC FIRE EXTINGUISHER CABINET. (JULINE "11-4872" OR APPROVED EQUAL) PROVIDE RATED CABINET WHEN LOCATED IN A RATED WALL.
- EXIT — EXISTING EXTERIOR EXIT TO REMAIN
- EXIT — INDICATES ALTERED EXIT LOCATION, SEE ELECTRICAL DRAWINGS FOR EXIT SIGN LOCATION AND DIRECTION
- PATH 'A' ----▷ — INDICATES EXIT TRAVEL DISTANCE
- 1 HOUR FIRE BARRIER - EXISTING TO REMAIN
- 1 HOUR FIRE WALL - UL DESIGN NO. U305, WITH OPENINGS AS SCHEDULED (20 MIN.)
- 2 HOUR FIRE WALL -EXISTING TO REMAIN

TRAVEL DISTANCES

PATH 'A'.....77'-4"
PATH 'B'.....91'-0"
PATH 'C'.....163'-6"

*MAXIMUM EXIT ACCESS TRAVEL DISTANCE: E & A OCCUPANCY = 200'-0" (PER NCSBC TABLE 1016.1)

**LEVEL OF EXIT DISCHARGE IS ON THE GROUND FLOOR

COMMON PATH DISTANCE

PATH 'D'..... (COMMON PATH HAS NOT BEEN ALTERED)

*COMMON PATH TRAVEL DISTANCE: A OCCUPANCY = 30'-0" (PER NCSBC SECTION 1028.8)

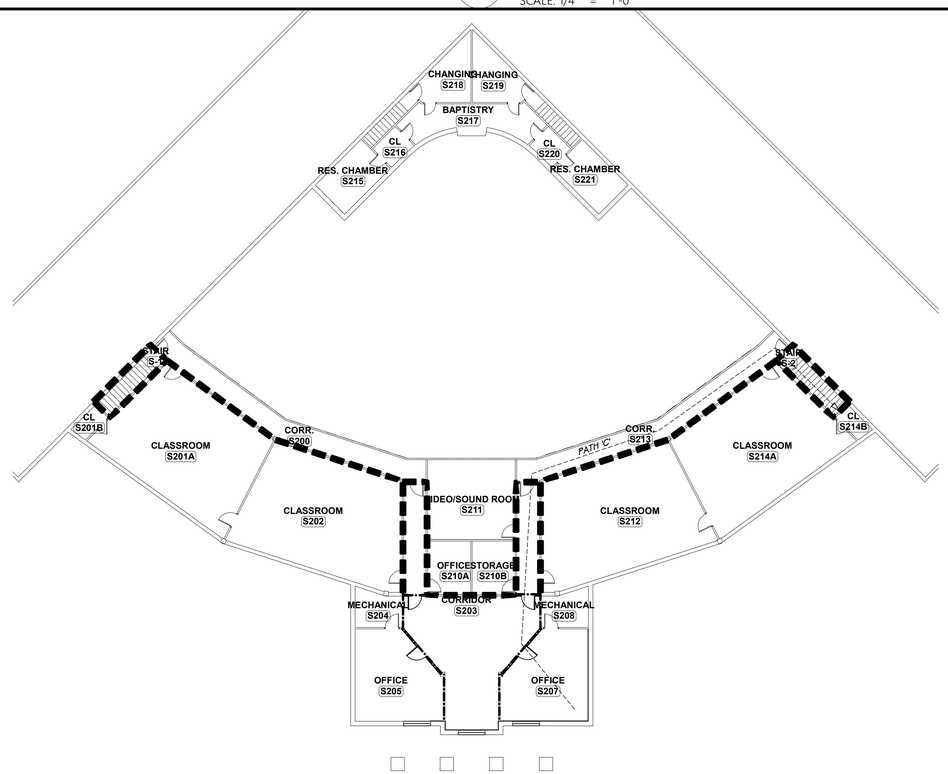

N

SANCTUARY BUILDING
SECOND FLR LIFE SAFETY PLAN (ALT.)

SCALE: 1/16" = 1'-0"

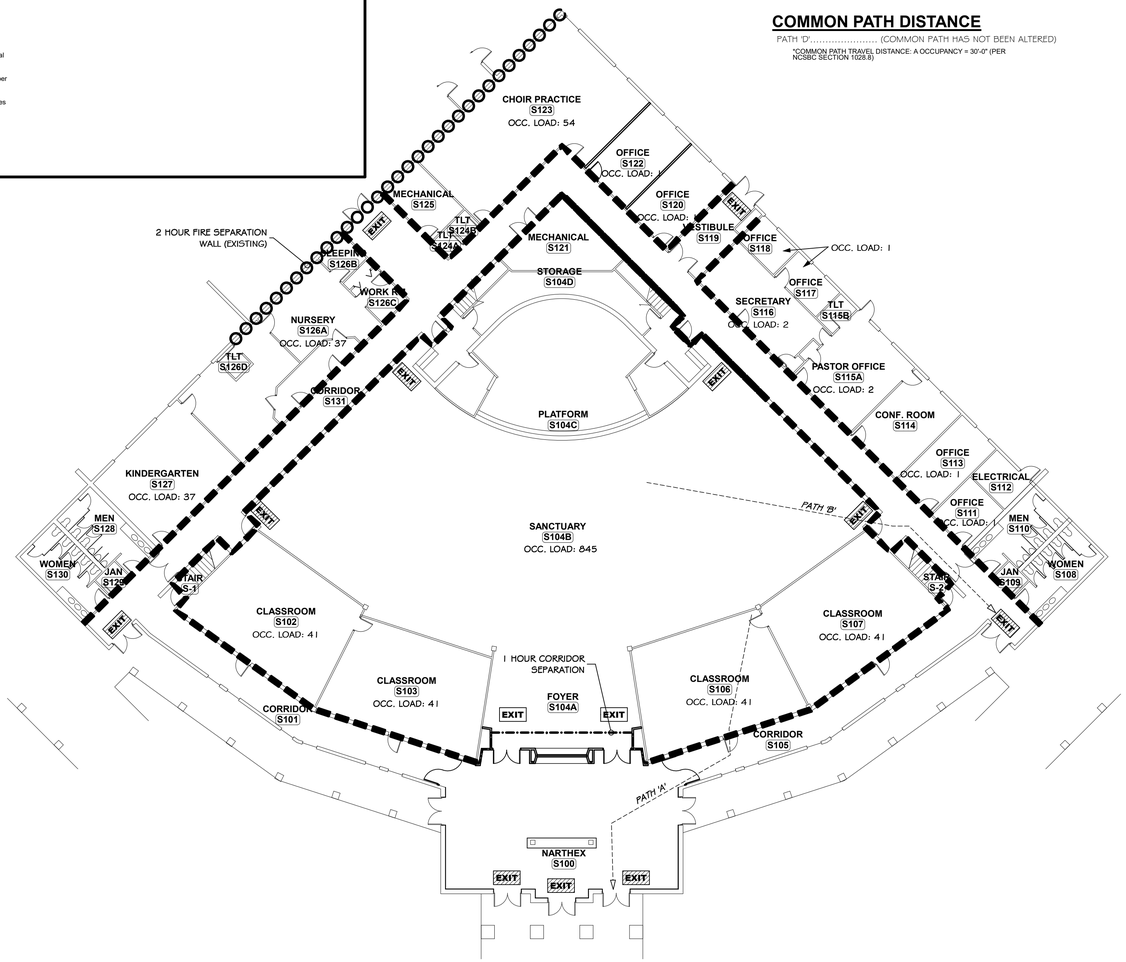

N

SANCTUARY BUILDING
FIRST FLR LIFE SAFETY PLAN (ALT.)

SCALE: 1/16" = 1'-0"

hostetlerarchitecture
■ ARCHITECTURE ■ PLANNING
3967 MARKET STREET
WILMINGTON, NC 28403
PHONE: 910.612.1119
www.hostetlerarchitecture.com

CONSULTANTS

RENOVATIONS TO

GRACE BAPTIST CHURCH

WILMINGTON
NORTH CAROLINA

HOSTETLER ARCHITECTURE STATE REGISTRATION — HOSTETLER ARCHITECTURE, PLLC, REGISTERED ARCHITECTURAL COMPANY, 53256, NORTH CAROLINA, WILMINGTON, NC

ARCHITECT OF RECORD — SHAWN E. HOSTETLER 11926 — SHAWN E. HOSTETLER, REGISTERED ARCHITECT, 11926, 12-8-19, NORTH CAROLINA, WILMINGTON, NC

CONSTRUCTION DOCUMENTS : 02.08.19

REVISIONS

MARK	DATE	DESCRIPTION
1		
2		
3		
4		

DRAWN BY: PROJ. MGR:

SHEET CONTENT

SANCTUARY BUILDING LIFE SAFETY PLAN (ALTERNATE)

JOB NO. 18013

SHEET G100

©2018

Printed 3/6/2019