

hostetlerarchitecture

ARCHITECTURE PLANNING

3967 MARKET STREET
WILMINGTON, NC 28403

PHONE: 910.612.1119

www.hostetlerarchitecture.com

CONSULTANTS

10755



McDOWELL CONSULTING
ENGINEERS, INC
P.O. BOX 367
HAMPSTEAD, NC 28443
TEL (910) 270-3747 FAX 270-3779
NC LICENSE NO. C-2546



RENOVATIONS TO

GRACE BAPTIST CHURCH

WILMINGTON
NORTH CAROLINA

CONSTRUCTION DOCUMENTS : 2.8.19

REVISIONS

MARK	DATE	DESCRIPTION
△		
△		
△		
△		

DRAWN BY: RSG PROJ. MGR: GLM


SHEET CONTENT

MESHAW BUILDING (BASE BID)
FIRST FLOOR PLAN - AREA A
FIRE ALARM

JOB NO.
18013

SHEET
FA101


SYMBOL	DESCRIPTION
[F]	NEW PULL STATION ALTERNATE BID FA1
[F]RL	EXISTING PULL STATION RELOCATE TO FINISHED WALL
[H]RL	EXISTING HEAT DETECTOR RELOCATE TO NEW CEILING
[S]RL	EXISTING SMOKE DETECTOR RELOCATE TO NEW CEILING
[H]E	EXISTING HORN/STROBE
[H]RL	EXISTING HORN/STROBE RELOCATE TO FINISHED WALL
[F]RL	EXISTING STROBE RELOCATE TO FINISHED WALL
[H]E	NEW HORN/STROBE ALTERNATE BID FA1
[F]E	NEW STROBE ALTERNATE BID FA1

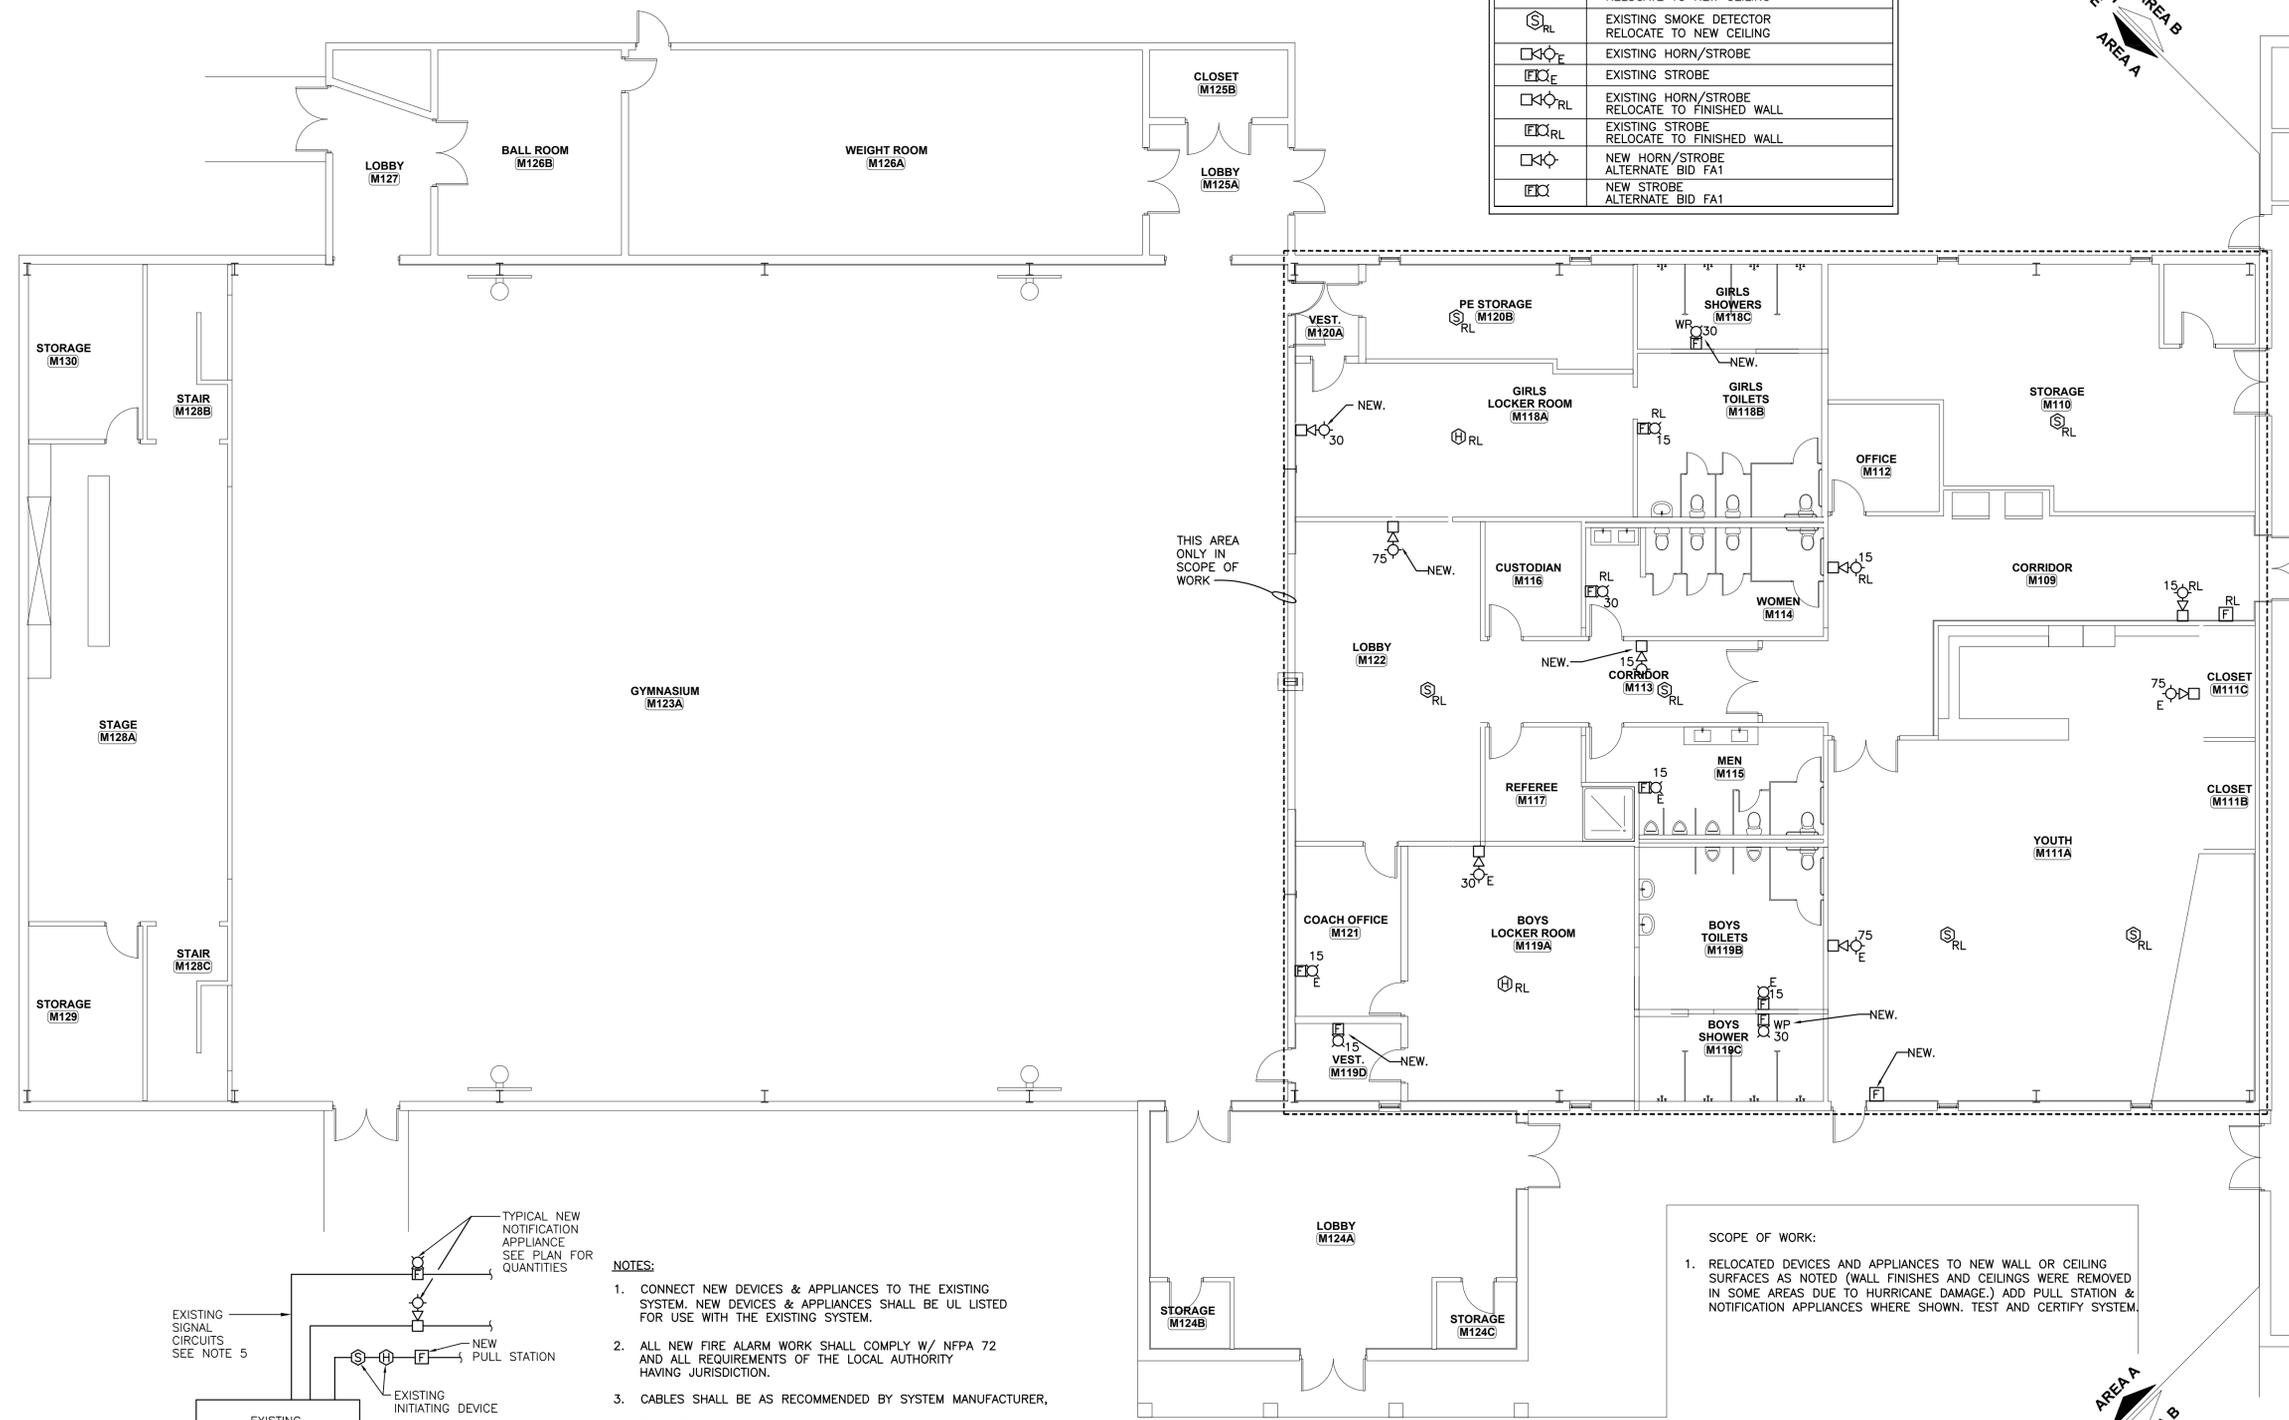

THIS AREA ONLY IN SCOPE OF WORK

SCOPE OF WORK:

1. RELOCATED DEVICES AND APPLIANCES TO NEW WALL OR CEILING SURFACES AS NOTED (WALL FINISHES AND CEILINGS WERE REMOVED IN SOME AREAS DUE TO HURRICANE DAMAGE.) ADD PULL STATION & NOTIFICATION APPLIANCES WHERE SHOWN. TEST AND CERTIFY SYSTEM.

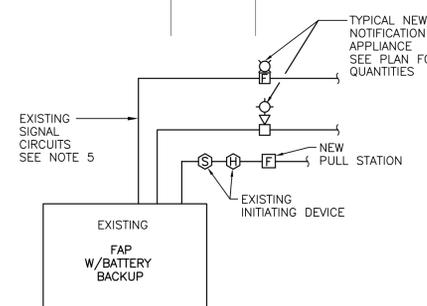

EXISTING FIRE ALARM RISER
NTS

NOTES:

1. CONNECT NEW DEVICES & APPLIANCES TO THE EXISTING SYSTEM. NEW DEVICES & APPLIANCES SHALL BE UL LISTED FOR USE WITH THE EXISTING SYSTEM.
2. ALL NEW FIRE ALARM WORK SHALL COMPLY W/ NFPA 72 AND ALL REQUIREMENTS OF THE LOCAL AUTHORITY HAVING JURISDICTION.
3. CABLES SHALL BE AS RECOMMENDED BY SYSTEM MANUFACTURER.
4. SYNCHRONIZE STROBES.
5. PROVIDE NEW NAC POWER SUPPLY IF REQUIRED.
6. TEST AND CERTIFY SYSTEM.
7. UPDATE OWNER'S DOCUMENTATION.
8. SHOP DRAWINGS SHALL BE SUBMITTED TO THE AHJ AND SHALL COMPLY WITH THE WILMINGTON FIRE PREVENTION F.A. PLAN REVIEW REQUIREMENTS POLICY.

MESHAW BUILDING (BASE BID)
FIRST FLOOR PLAN AREA A - FIRE ALARM
SCALE: 1/8"=1'-0"